

Operation level	Adi,141
Communication operation level	Adi,109
Operation active	Bi,1
Low speed operation active	Bi,3
High speed operation active	Bi,4
Damper operation active	Bi,2
Triggered alarm #1	Adi,144
A-alarm active	Bi,13
B-alarm active	Bi,14
Alarm reset	Bo,1

EA Air flow	Ai,3
EA Fan level	Ai,24
EA low speed air flow set point	Ao,2
EA high speed air flow set point	Ao,4

Outdoor temperature	Ai,49
---------------------	-------

SA AHU filter pressure level	Ai,17
SA AHU filter pressure alarm limit	Ai,18
Heat exchanger regulator level	Ai,63

SA Air flow	Ai,1
SA Fan level	Ai,23
	Ao,1
SA high speed air flow set point	Ao,3
SA low speed air flow set point	


EA AHU filter pressure level	Ai,19
EA AHU filter pressure alarm limit	Ai,20

EA Duct pressure	Ai,7
EA low speed pressure set point	Ao,10
EA high speed pressure set point	Ao,12

EA Temperature	Ai,46
EA/Room temperature set point	Ao,71
SA min temp set point	Ao,72
SA max temp set point	Ao,73

SA Duct pressure	Ai,5
SA low speed pressure set point	Ao,9
SA high speed pressure set point	Ao,11

SA Temperature	Ai,44
SA temperature set point	Ao,70
ERS 1 diff	Ao,60

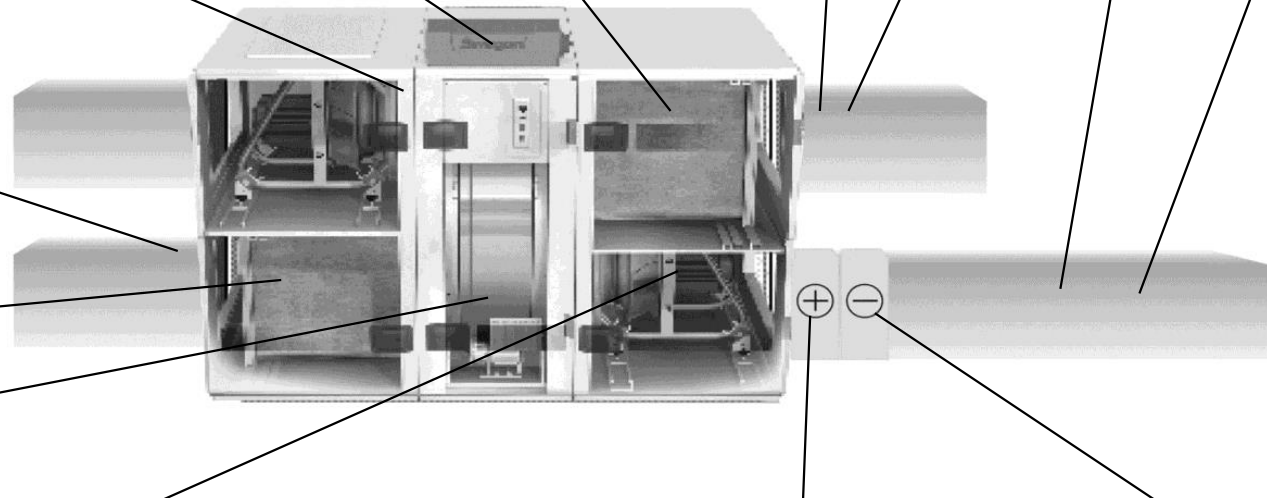

Reheat regulator level	Ai,66
Re-heat output	Bi,38
Re-heat anti frost temp/overheat ir	Ai,101

Cool regulator level	Ai,73
Cool output 1	Bi,43
Cool output 2	Bi,44